

**AIR PERMIT DETERMINATION
GOLDTOWN TOWER
Goldtown, Jackson County, WV**



Prepared For:
Cellco Partnership, dba Verizon Wireless
18 Abele Road
Bridgeville, PA 15017

Project No.: R4024400-150639.01
Date: 12 February 2015



Prepared By:
Mead & Hunt, Inc
400 Tracy Way, Suite 200
Charleston, West Virginia 25311



WEST VIRGINIA
DEPARTMENT OF ENVIRONMENTAL PROTECTION
DIVISION OF AIR QUALITY
601 57th Street, SE
Charleston, WV 25304
Phone: (304) 926-0475
www.dep.wv.gov/daq

**PERMIT DETERMINATION FORM
(PDF)**

FOR AGENCY USE ONLY: PLANT I.D. # _____

PDF # _____ PERMIT WRITER: _____

1. NAME OF APPLICANT (AS REGISTERED WITH THE WV SECRETARY OF STATE'S OFFICE):

Cellco Partnership, dba Verizon Wireless

2. NAME OF FACILITY (IF DIFFERENT FROM ABOVE):

Goldtown Tower

3. NORTH AMERICAN INDUSTRY CLASSIFICATION SYSTEM (NAICS) CODE:

334220

4A. MAILING ADDRESS:

18 Abele Road
Bridgeville, PA 15017

4B. PHYSICAL ADDRESS:

357 Duff Hill
Kenna, WV 25248

5A. DIRECTIONS TO FACILITY (PLEASE PROVIDE MAP AS ATTACHMENT A):

From Charleston, go north on I-77 to exit 119 to CR 21 toward Goldtown. Take CR21 for 1.4 miles, turn right onto existing dirt road (0.45 miles). Turn left into field and drive along fence line. Proposed site is in approximately 400 feet..

5B. NEAREST ROAD:

CR21

5C. NEAREST CITY OR TOWN:

Ripley

5D. COUNTY:

Jackson

5E. UTM NORTHING (KM):

4274017

5F. UTM EASTING (KM):

443560

5G. UTM ZONE:

17S

6A. INDIVIDUAL TO CONTACT IF MORE INFORMATION IS REQUIRED:

Paul (Kim) Marshall

6B. TITLE:

Real Estate Specialist

6C. TELEPHONE:

304-422-3055

6D. FAX:

6E. E-MAIL:

Paul.Marshall@VerizonWireless.com

7A. DAQ PLANT I.D. NO. (FOR AN EXISTING FACILITY ONLY):

7B. PLEASE LIST ALL CURRENT 45CSR13, 45CSR14, 45CSR19 AND/OR TITLE V (45CSR30) PERMIT NUMBERS ASSOCIATED WITH THIS PROCESS (FOR AN EXISTING FACILITY ONLY):

none

7C. IS THIS PDF BEING SUBMITTED AS THE RESULT OF AN ENFORCEMENT ACTION? IF YES, PLEASE LIST: NO

8A. TYPE OF EMISSION SOURCE (CHECK ONE):

NEW SOURCE ADMINISTRATIVE UPDATE

MODIFICATION OTHER (PLEASE EXPLAIN IN 11B)

8B. IF ADMINISTRATIVE UPDATE, DOES DAQ HAVE THE APPLICANT'S CONSENT TO UPDATE THE EXISTING PERMIT WITH THE INFORMATION CONTAINED HEREIN?

YES NO

9. IS DEMOLITION OR PHYSICAL RENOVATION AT AN EXISTING FACILITY INVOLVED? YES NO

10A. DATE OF ANTICIPATED INSTALLATION OR CHANGE:

3/15/2015

10B. DATE OF ANTICIPATED START-UP:

3/15/2015

11A. PLEASE PROVIDE A DETAILED PROCESS FLOW DIAGRAM SHOWING EACH PROPOSED OR MODIFIED PROCESS EMISSION POINT AS ATTACHMENT B. Diesel generator set at the tower site, see Attachment B.

11B. PLEASE PROVIDE A DETAILED PROCESS DESCRIPTION AS ATTACHMENT C.

12. PLEASE PROVIDE MATERIAL SAFETY DATA SHEETS (MSDS) FOR ALL MATERIALS PROCESSED, USED OR PRODUCED AS ATTACHMENT D. FOR CHEMICAL PROCESSES, PLEASE PROVIDE A MSDS FOR EACH COMPOUND EMITTED TO AIR.

13A. REGULATED AIR POLLUTANT EMISSIONS:

⇒ **FOR A NEW FACILITY**, PLEASE PROVIDE PLANT WIDE EMISSIONS BASED ON THE POTENTIAL TO EMIT (PTE) FOR THE FOLLOWING AIR POLLUTANTS INCLUDING ALL PROCESSES.

⇒ **FOR AN EXISTING FACILITY**, PLEASE PROVIDE THE PROPOSED CHANGE IN EMISSIONS BASED ON THE PTE OF ALL PROCESS CHANGES FOR THE FOLLOWING AIR POLLUTANTS.

PTE FOR A GIVEN POLLUTANT IS TYPICALLY BEFORE AIR POLLUTION CONTROL DEVICES AND IS COLLECTED BASED ON THE MAXIMUM DESIGN CAPACITY OF PROCESS EQUIPMENT.

POLLUTANT	HOURLY PTE (LB/HR)	YEARLY PTE (TON/YR) (HOURLY PTE MULTIPLIED BY 8760 HR/YR) DIVIDED BY 2000 LB/TON
PM	0.03	0.12
PM ₁₀	0.02	0.09
VOCs	0.165	0.73
CO	0.12	0.53
NO _x	0.46	2.01
SO ₂	0.14	0.60
Pb	-	-
HAPs (AGGREGATE AMOUNT)	Formaldehyde 0.08	Formaldehyde 0.35
TAPs (INDIVIDUALLY)*	-	-
OTHER (INDIVIDUALLY)*		

* ATTACH ADDITIONAL PAGES AS NEEDED

13B. PLEASE PROVIDE ALL SUPPORTING CALCULATIONS AS ATTACHMENT E.

CALCULATE AN HOURLY AND YEARLY PTE OF EACH PROCESS EMISSION POINT (SHOWN IN YOUR DETAILED PROCESS FLOW DIAGRAM) FOR ALL AIR POLLUTANTS LISTED ABOVE INCLUDING INDIVIDUAL HAP'S (LISTED IN SECTION 112[b] OF THE 1990 CAAA), TAP'S (LISTED IN 45CSR27), AND OTHER AIR POLLUTANTS (E.G. POLLUTANTS LISTED IN TABLE 45-13A OF 45CSR13, MINERAL ACIDS PER 45CSR7, ETC.).

14. CERTIFICATION OF DATA

I, MIKE MALENICH ATTEST THAT ALL THE REPRESENTATIONS CONTAINED IN THIS APPLICATION, OR APPENDED HERETO, ARE TRUE, ACCURATE, AND COMPLETE TO THE BEST OF MY KNOWLEDGE BASED ON INFORMATION AND BELIEF AFTER REASONABLE INQUIRY, AND THAT I AM A **RESPONSIBLE OFFICIAL**** (PRESIDENT, VICE PRESIDENT, SECRETARY OR TREASURER, GENERAL PARTNER OR SOLE PROPRIETOR) OF THE APPLICANT.

SIGNATURE OF RESPONSIBLE OFFICIAL: 

TITLE: DIRECTOR ENGINEERING DATE: 2 / 12 / 15

** THE DEFINITION OF THE PHRASE 'RESPONSIBLE OFFICIAL' CAN BE FOUND AT 45CSR13, SECTION 2.23.

NOTE: PLEASE CHECK ENCLOSED ATTACHMENTS:

- ATTACHMENT A ATTACHMENT B ATTACHMENT C ATTACHMENT D ATTACHMENT E

RECORDS ON ALL CHANGES ARE REQUIRED TO BE KEPT AND MAINTAINED ON-SITE FOR TWO (2) YEARS.

THE PERMIT DETERMINATION FORM WITH THE INSTRUCTIONS CAN BE FOUND ON DAQ'S PERMITTING SECTION WEB SITE:

www.dep.wv.gov/daq




Attachment A Topo Map

Attachment B

Process Flow Diagram

**GOLDTOWN CELL SITE
CONSTRUCTION PLAN
JACKSON COUNTY, WEST VIRGINIA**

NOTE: STRUCTURE SHOWN IS SCHEMATIC IN NATURE ONLY. THE CONTRACTOR SHALL COORDINATE WITH THE CELL PROVIDER FOR ANTENNA MOUNTS AND CABLE SUPPORT MOUNTS.

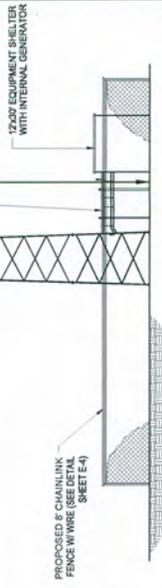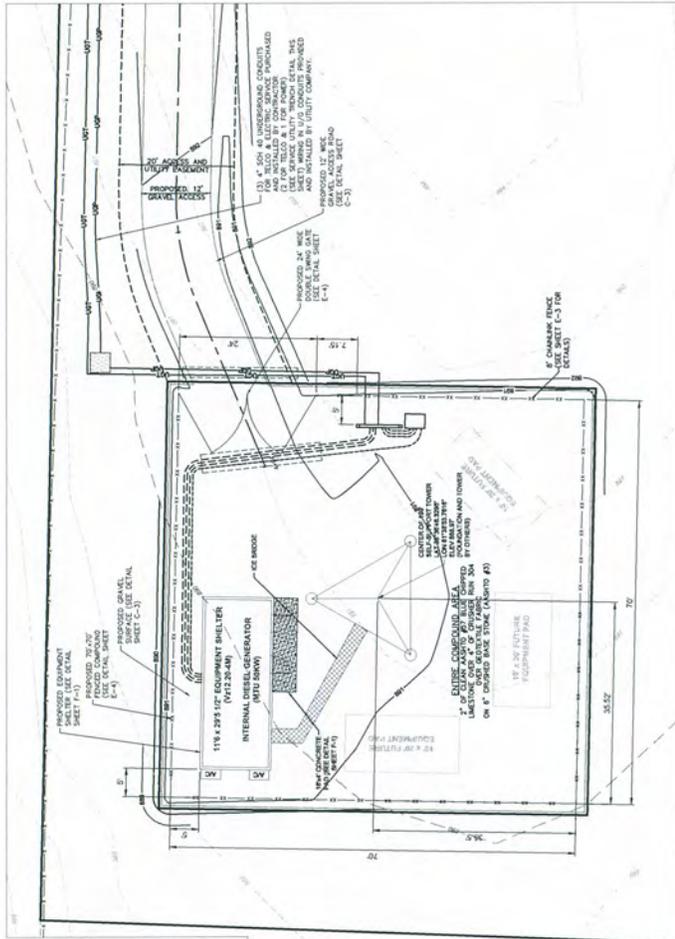

**ELEVATION
SCALE: NONE**

NOTE: CONTRACTOR SHALL LOCATE AND VERIFY ALL EXISTING UNDERGROUND UTILITIES PRIOR TO CONSTRUCTION. ALL ELEVATIONS SHOWN ARE IN FEET UNLESS OTHERWISE SPECIFIED.

- PROVIDE ALL TRENCHING AND BACKFILLING THAT IS REQUIRED FOR THE INSTALLATION OF THE UNDERGROUND DISTRIBUTION FACILITIES.
- EXCAVATE TRENCH IN THE LOCATION INDICATED BY THE COMPANY APPROVED ELECTRICAL LAYOUT DIAGRAMS OF FIELD SPACES.
- CONDUIT TRENCH TO BE THE DIMENSIONS SHOWN ABOVE. PRELIMINARY, SECONDARY, AND SERVICE LATERAL CONDUITS MAY BE INSTALLED IN THE SAME TRENCH, PROVIDED THE TRENCH TRENCH DIMENSIONS ARE USED.
- FOR THE PURPOSE OF THE ELECTRICAL TRENCHING WORK, CONTRACTOR SHALL USE THE FOLLOWING:
 - 1. THE BOTTOM OF THE TRENCH SHALL BE THE SIZE OF RIGID CONDUIT OR BUNDLE OBJECTS. A 2" RADIUS OF APPROVED MATERIAL SHALL BE DETAIL BELOW THE RIGID CONDUIT OR BUNDLE OBJECTS.
 - 2. ALL TRENCHES SHALL BE FILL WITH COMPANY APPROVED MATERIAL WITH THE COMPANY APPROVED COMPACTOR. THE DIMENSIONS OF THE TRENCH SHALL BE MAINTAINED TO ALLOW CORRECT BACKFILL COMPACTURE TO TAKE PLACE.
 - 3. ALL TRENCHES SHALL BE FILL WITH COMPANY APPROVED MATERIAL WITH THE COMPANY APPROVED COMPACTOR.
 - 4. DISCOVERY OF THE TRENCH DEPTH SHALL BE MADE WITH A TRENCH PROBE.
- NO SEPARATION BETWEEN THE ELECTRICAL CABLES AND TELEPHONE CABLES IS REQUIRED BY THE COMPANY UNLESS AS INDICATED IN THE TRENCHING AND BACKFILLING DETAILS. ALL ELECTRICAL CABLES SHALL BE INSTALLED IN THE TRENCHES WITH THE TELEPHONE CABLES. ALL ELECTRICAL CABLES SHALL BE INSTALLED IN THE TRENCHES WITH THE TELEPHONE CABLES. ALL ELECTRICAL CABLES SHALL BE INSTALLED IN THE TRENCHES WITH THE TELEPHONE CABLES.
- ALL ELECTRICAL CABLES SHALL BE INSTALLED IN THE TRENCHES WITH THE TELEPHONE CABLES. ALL ELECTRICAL CABLES SHALL BE INSTALLED IN THE TRENCHES WITH THE TELEPHONE CABLES.
- ALL ELECTRICAL CABLES SHALL BE INSTALLED IN THE TRENCHES WITH THE TELEPHONE CABLES. ALL ELECTRICAL CABLES SHALL BE INSTALLED IN THE TRENCHES WITH THE TELEPHONE CABLES.
- ALL ELECTRICAL CABLES SHALL BE INSTALLED IN THE TRENCHES WITH THE TELEPHONE CABLES. ALL ELECTRICAL CABLES SHALL BE INSTALLED IN THE TRENCHES WITH THE TELEPHONE CABLES.

SCHEDULE OF REVISIONS

NO.	DATE	DESCRIPTION
7	REV 1	ISSUED FOR PERMIT
6	REV 2	ISSUED FOR REVIEW
5	REV 3	ISSUED FOR REVIEW
4	REV 4	ISSUED FOR REVIEW
3	REV 5	ISSUED FOR REVIEW
2	REV 6	ISSUED FOR REVIEW
1	REV 7	ISSUED FOR REVIEW

NOTES

FOR CONSTRUCTION

TERRADON
P.O. Box 519
Nitro, West Virginia 25143
(304) 755-8291 FAX 755-2636

verizon wireless
18 Alape Road
Pittsburgh, PA 15217

**SITE PLAN AND ELEVATION
VERIZON WIRELESS
GOLDTOWN CELL SITE**

C-2

Attachment C

Process Description

ATTACHMENT C: PROCESS DESCRIPTION

The installation will be a John Deere 50KW, Tier 3 Diesel generator, Model 4045TF280D. The generator will be used to supply power to the wireless communications facility in case of power failure. During normal operation, the generator may be exercised weekly for approximately one hour for an annual run time of 52 hours. It is not expected that the generator will not exceed 8,760 hours/year allowed by the State of West Virginia.

The generator/shelters installed on all properties have the following useful fuel safeguards:

- The generator room has a spill containment pan that is rated at 125% of the fuel stored in the diesel generator.
- The internal generator fuel tank is a U.L. 142 and NFPA 30 approved double wall sub-base fuel tank and meets Local, State, and Federal codes.
- The generators have remote alarms that are monitored 24 x 7. There is a fuel tank rupture sensor that reports back any spillage that occurs within the fuel containment pan. The network also monitors low-level fuel, generator on and operating in emergency mode.
- For remote generator installations (generators not installed in a shelter), the entire unit is housed in a "Crystal Quiet Enclosure" with an internally mounted silencer.

Attachment D

MSDS for Diesel Fuel

Product Name: NO. 2 DIESEL FUEL

Revision Date: 09 Jan 2015

Page 1 of 14

SAFETY DATA SHEET

SECTION 1 PRODUCT AND COMPANY IDENTIFICATION

PRODUCT

Product Name: NO. 2 DIESEL FUEL
Product Description: Hydrocarbons and Additives
Product Code: 123455-22, 123455-29, 152017-00
Intended Use: Diesel engine fuel, Heating Oil

COMPANY IDENTIFICATION

Supplier: EXXON MOBIL CORPORATION
3225 GALLOWS RD.
FAIRFAX, VA. 22037 USA
24 Hour Health Emergency: 609-737-4411
Transportation Emergency Phone: 800-424-9300 or 703-527-3887 CHEMTREC
Product Technical Information: 800-662-4525
MSDS Internet Address: <http://www.exxon.com>, <http://www.mobil.com>

SECTION 2 HAZARDS IDENTIFICATION

This material is hazardous according to regulatory guidelines (see (M)SDS Section 15).

CLASSIFICATION:

Flammable liquid: Category 3.
Acute inhalation toxicant: Category 4. Skin irritation: Category 2. Carcinogen: Category 2. Specific target organ toxicant (repeated exposure): Category 2. Aspiration toxicant: Category 1.

LABEL:

Pictogram:



Signal Word: Danger

Hazard Statements:

H226: Flammable liquid and vapor. H304: May be fatal if swallowed and enters airways. H315: Causes skin irritation. H332: Harmful if inhaled. H351: Suspected of causing cancer. H373: May cause damage to organs through prolonged or repeated exposure. Liver, Bone marrow, Thymus

Product Name: NO. 2 DIESEL FUEL

Revision Date: 09 Jan 2015

Page 2 of 14

Precautionary Statements:

P101: If medical advice is needed, have product container or label at hand. P102: Keep out of reach of children. P103: Read label before use. P201: Obtain special instructions before use. P202: Do not handle until all safety precautions have been read and understood. P210: Keep away from heat/sparks/open flames/hot surfaces. -- No smoking. P233: Keep container tightly closed. P240: Ground / bond container and receiving equipment. P241: Use explosion-proof electrical, ventilating, and lighting equipment. P242: Use only non-sparking tools. P243: Take precautionary measures against static discharge. P260: Do not breathe mist / vapours. P264: Wash skin thoroughly after handling. P271: Use only outdoors or in a well-ventilated area. P273: Avoid release to the environment. P280: Wear protective gloves/protective clothing/eye protection/face protection. P301 + P310: IF SWALLOWED: Immediately call a POISON CENTER or doctor/physician. P302 + P352: IF ON SKIN: Wash with plenty of soap and water. P304 + P340: IF INHALED: Remove person to fresh air and keep comfortable for breathing. P308 + P313: IF exposed or concerned: Get medical advice/ attention. P312: Call a POISON CENTER or doctor/physician if you feel unwell. P331: Do NOT induce vomiting. P332 + P313: If skin irritation occurs: Get medical advice/ attention. P362 + P364: Take off contaminated clothing and wash it before reuse. P370 + P378: In case of fire: Use water fog, foam, dry chemical or carbon dioxide (CO₂) to extinguish. P391: Collect spillage. P403 + P235: Store in a well-ventilated place. Keep cool. P405: Store locked up. P501: Dispose of contents and container in accordance with local regulations.

Contains: DIESEL OIL..C9-20

Other hazard information:

HAZARD NOT OTHERWISE CLASSIFIED (HNOC): None as defined under 29 CFR 1900.1200.

PHYSICAL / CHEMICAL HAZARDS

Material can accumulate static charges which may cause an ignition. Material can release vapors that readily form flammable mixtures. Vapor accumulation could flash and/or explode if ignited.

HEALTH HAZARDS

May cause central nervous system depression. High-pressure injection under skin may cause serious damage. Under conditions of poor personal hygiene and prolonged repeated contact, some polycyclic aromatic compounds (PACs) have been suspected as a cause of skin cancer in humans. May be irritating to the eyes, nose, throat, and lungs.

ENVIRONMENTAL HAZARDS

Expected to be toxic to aquatic organisms. May cause long-term adverse effects in the aquatic environment.

NFPA Hazard ID:	Health: 2	Flammability: 2	Reactivity: 0
HMIS Hazard ID:	Health: 2*	Flammability: 2	Reactivity: 0

NOTE: This material should not be used for any other purpose than the intended use in Section 1 without expert advice. Health studies have shown that chemical exposure may cause potential human health risks which may vary from person to person.

SECTION 3

COMPOSITION / INFORMATION ON INGREDIENTS

This material is defined as a mixture.

12/35

Product Name: NO. 2 DIESEL FUEL

Revision Date: 09 Jan 2015

Page 3 of 14

Hazardous Substance(s) or Complex Substance(s) required for disclosure

Name	CAS#	Concentration*	GHS Hazard Codes
DIESEL OIL..C9-20	68334-30-5	80 - > 99%	H226, H304, H332, H351, H315, H373, H401, H411

Hazardous Constituent(s) Contained in Complex Substance(s) required for disclosure

Name	CAS#	Concentration*	GHS Hazard Codes
ETHYL BENZENE	100-41-4	0.1 - 1%	H225, H332, H351
NAPHTHALENE	91-20-3	0.1 - 1%	H302, H351, H400(M factor 1), H410(M factor 1)

* All concentrations are percent by weight unless material is a gas. Gas concentrations are in percent by volume.

NOTE: Composition may contain up to 0.5% performance additives and / or dyes.

As per paragraph (i) of 29 CFR 1910.1200, formulation is considered a trade secret and specific chemical identity and exact percentage (concentration) of composition may have been withheld. Specific chemical identity and exact percentage composition will be provided to health professionals, employees, or designated representatives in accordance with applicable provisions of paragraph (i).

SECTION 4 FIRST AID MEASURES

INHALATION

Remove from further exposure. For those providing assistance, avoid exposure to yourself or others. Use adequate respiratory protection. If respiratory irritation, dizziness, nausea, or unconsciousness occurs, seek immediate medical assistance. If breathing has stopped, assist ventilation with a mechanical device or use mouth-to-mouth resuscitation.

SKIN CONTACT

Remove contaminated clothing. Dry wipe exposed skin and cleanse with waterless hand cleaner and follow by washing thoroughly with soap and water. For those providing assistance, avoid further skin contact to yourself or others. Wear impervious gloves. Launder contaminated clothing separately before reuse. Discard contaminated articles that cannot be laundered. If product is injected into or under the skin, or into any part of the body, regardless of the appearance of the wound or its size, the individual should be evaluated immediately by a physician as a surgical emergency. Even though initial symptoms from high pressure injection may be minimal or absent, early surgical treatment within the first few hours may significantly reduce the ultimate extent of injury.

EYE CONTACT

Flush thoroughly with water. If irritation occurs, get medical assistance.

INGESTION

Seek immediate medical attention. Do not induce vomiting.

NOTE TO PHYSICIAN

If ingested, material may be aspirated into the lungs and cause chemical pneumonitis. Treat appropriately.

PRE-EXISTING MEDICAL CONDITIONS WHICH MAY BE AGGRAVATED BY EXPOSURE

Contains hydrocarbon solvent/petroleum hydrocarbons; skin contact may aggravate an existing dermatitis.

Product Name: NO. 2 DIESEL FUEL
Revision Date: 09 Jan 2015
Page 4 of 14

SECTION 5 FIRE FIGHTING MEASURES

EXTINGUISHING MEDIA

Appropriate Extinguishing Media: Use water fog, foam, dry chemical or carbon dioxide (CO₂) to extinguish flames.

Inappropriate Extinguishing Media: Straight Streams of Water

FIRE FIGHTING

Fire Fighting Instructions: Evacuate area. Prevent runoff from fire control or dilution from entering streams, sewers, or drinking water supply. Firefighters should use standard protective equipment and in enclosed spaces, self-contained breathing apparatus (SCBA). Use water spray to cool fire exposed surfaces and to protect personnel.

Unusual Fire Hazards: Hazardous material. Firefighters should consider protective equipment indicated in Section 8.

Hazardous Combustion Products: Sulfur oxides, Oxides of carbon, Incomplete combustion products, Smoke, Fume, Aldehydes

FLAMMABILITY PROPERTIES

Flash Point [Method]: >38°C (100°F) [ASTM D-93]

Flammable Limits (Approximate volume % in air): LEL: 0.6 UEL: 7.0

Autoignition Temperature: >200°C (392°F)

SECTION 6 ACCIDENTAL RELEASE MEASURES

NOTIFICATION PROCEDURES

In the event of a spill or accidental release, notify relevant authorities in accordance with all applicable regulations. US regulations require reporting releases of this material to the environment which exceed the applicable reportable quantity or oil spills which could reach any waterway including intermittent dry creeks. The National Response Center can be reached at (800)424-8802.

PROTECTIVE MEASURES

Avoid contact with spilled material. Warn or evacuate occupants in surrounding and downwind areas if required due to toxicity or flammability of the material. See Section 5 for fire fighting information. See the Hazard Identification Section for Significant Hazards. See Section 4 for First Aid Advice. See Section 8 for advice on the minimum requirements for personal protective equipment. Additional protective measures may be necessary, depending on the specific circumstances and/or the expert judgment of the emergency responders.

For emergency responders: Respiratory protection: half-face or full-face respirator with filter(s) for organic vapor and, when applicable, H₂S, or Self Contained Breathing Apparatus (SCBA) can be used depending on the size of spill and potential level of exposure. If the exposure cannot be completely characterized or an oxygen deficient atmosphere is possible or anticipated, SCBA is recommended. Work gloves that are resistant to aromatic hydrocarbons are recommended. Note: gloves made of polyvinyl acetate (PVA) are not water-resistant and are not suitable for emergency use. Chemical goggles are recommended if splashes or contact with eyes is possible. Small spills: normal antistatic work clothes are usually adequate. Large spills: full body suit of chemical resistant, antistatic material is recommended.

SPILL MANAGEMENT

Land Spill: Eliminate all ignition sources (no smoking, flares, sparks or flames in immediate area). Stop leak

Product Name: NO. 2 DIESEL FUEL

Revision Date: 09 Jan 2015

Page 5 of 14

if you can do it without risk. All equipment used when handling the product must be grounded. Do not touch or walk through spilled material. Prevent entry into waterways, sewer, basements or confined areas. A vapor suppressing foam may be used to reduce vapors. Use clean non-sparking tools to collect absorbed material. Absorb or cover with dry earth, sand or other non-combustible material and transfer to containers. Large Spills: Water spray may reduce vapor; but may not prevent ignition in closed spaces.

Water Spill: Stop leak if you can do it without risk. Eliminate sources of ignition. Warn other shipping. If the Flash Point exceeds the Ambient Temperature by 10 degrees C or more, use containment booms and remove from the surface by skimming or with suitable absorbents when conditions permit. If the Flash Point does not exceed the Ambient Air Temperature by at least 10C, use booms as a barrier to protect shorelines and allow material to evaporate. Seek the advice of a specialist before using dispersants.

Water spill and land spill recommendations are based on the most likely spill scenario for this material; however, geographic conditions, wind, temperature, (and in the case of a water spill) wave and current direction and speed may greatly influence the appropriate action to be taken. For this reason, local experts should be consulted. Note: Local regulations may prescribe or limit action to be taken.

ENVIRONMENTAL PRECAUTIONS

Large Spills: Dike far ahead of liquid spill for later recovery and disposal. Prevent entry into waterways, sewers, basements or confined areas.

SECTION 7

HANDLING AND STORAGE

HANDLING

Avoid all personal contact. Do not siphon by mouth. Do not use as a cleaning solvent or other non-motor fuel uses. For use as a motor fuel only. It is dangerous and/or unlawful to put fuel into unapproved containers. Do not fill container while it is in or on a vehicle. Static electricity may ignite vapors and cause fire. Place container on ground when filling and keep nozzle in contact with container. Do not use electronic devices (including but not limited to cellular phones, computers, calculators, pagers or other electronic devices, etc.) in or around any fueling operation or storage area unless the devices are certified intrinsically safe by an approved national testing agency and to the safety standards required by national and/or local laws and regulations. Prevent small spills and leakage to avoid slip hazard. Material can accumulate static charges which may cause an electrical spark (ignition source). Use proper bonding and/or ground procedures. However, bonding and grounds may not eliminate the hazard from static accumulation. Consult local applicable standards for guidance. Additional references include American Petroleum Institute 2003 (Protection Against Ignitions Arising out of Static, Lightning and Stray Currents) or National Fire Protection Agency 77 (Recommended Practice on Static Electricity) or CENELEC CLC/TR 50404 (Electrostatics - Code of practice for the avoidance of hazards due to static electricity).

Static Accumulator: This material is a static accumulator. A liquid is typically considered a nonconductive, static accumulator if its conductivity is below 100 pS/m (100×10^{-12} Siemens per meter) and is considered a semiconductive, static accumulator if its conductivity is below 10,000 pS/m. Whether a liquid is nonconductive or semiconductive, the precautions are the same. A number of factors, for example liquid temperature, presence of contaminants, anti-static additives and filtration can greatly influence the conductivity of a liquid.

STORAGE

The container choice, for example storage vessel, may effect static accumulation and dissipation. Keep container closed. Handle containers with care. Open slowly in order to control possible pressure release. Store in a cool, well-ventilated area. Storage containers should be grounded and bonded. Fixed storage containers, transfer containers and associated equipment should be grounded and bonded to prevent accumulation of static charge. Keep away from incompatible materials.

15 / 35

Product Name: NO. 2 DIESEL FUEL

Revision Date: 09 Jan 2015

Page 6 of 14

SECTION 8 EXPOSURE CONTROLS / PERSONAL PROTECTION

EXPOSURE LIMIT VALUES

Exposure limits/standards (Note: Exposure limits are not additive)

Substance Name	Form	Limit / Standard			NOTE	Source
DIESEL OIL..C9-20	Stable Aerosol.	TWA	5 mg/m3		N/A	ExxonMobil
DIESEL OIL..C9-20	Vapor.	TWA	200 mg/m3		N/A	ExxonMobil
DIESEL OIL..C9-20 [total hydrocarb, vapor&aerosol]	Inhalable fraction and vapor	TWA	100 mg/m3		Skin	ACGIH
ETHYL BENZENE		TWA	435 mg/m3	100 ppm	N/A	OSHA Z1
ETHYL BENZENE		TWA	20 ppm		N/A	ACGIH
NAPHTHALENE		TWA	50 mg/m3	10 ppm	N/A	OSHA Z1
NAPHTHALENE		TWA	10 ppm		Skin	ACGIH

NOTE: Limits/standards shown for guidance only. Follow applicable regulations.

Biological limits

Substance	Specimen	Sampling Time	Limit	Determinant	Source
ETHYL BENZENE	Creatinine in urine	End of shift	0.15 g/g	Sum of mandelic acid and phenylglyoxylic acid	ACGIH BELs (BEIs)
NAPHTHALENE	No Biological Specimen provided	End of shift	Not Assigned	1-Naphthol, with hydrolysis + 2-Naphthol, with hydrolysis	ACGIH BELs (BEIs)

ENGINEERING CONTROLS

The level of protection and types of controls necessary will vary depending upon potential exposure conditions. Control measures to consider:

Use explosion-proof ventilation equipment to stay below exposure limits.

PERSONAL PROTECTION

Personal protective equipment selections vary based on potential exposure conditions such as applications, handling practices, concentration and ventilation. Information on the selection of protective equipment for use with this material, as provided below, is based upon intended, normal usage.

Respiratory Protection: If engineering controls do not maintain airborne contaminant concentrations at a level which is adequate to protect worker health, an approved respirator may be appropriate. Respirator selection, use, and maintenance must be in accordance with regulatory requirements, if applicable. Types of respirators to be considered for this material include:

Half-face filter respirator

For high airborne concentrations, use an approved supplied-air respirator, operated in positive pressure mode. Supplied air respirators with an escape bottle may be appropriate when oxygen levels are inadequate, gas/vapor warning properties are poor, or if air purifying filter capacity/rating may be exceeded.

16/35

Product Name: NO. 2 DIESEL FUEL

Revision Date: 09 Jan 2015

Page 7 of 14

Hand Protection: Any specific glove information provided is based on published literature and glove manufacturer data. Glove suitability and breakthrough time will differ depending on the specific use conditions. Contact the glove manufacturer for specific advice on glove selection and breakthrough times for your use conditions. Inspect and replace worn or damaged gloves. The types of gloves to be considered for this material include:

Chemical resistant gloves are recommended. If contact with forearms is likely wear gauntlet style gloves.

Eye Protection: If contact with material is likely, chemical goggles are recommended.

Skin and Body Protection: Any specific clothing information provided is based on published literature or manufacturer data. The types of clothing to be considered for this material include:

Chemical/oil resistant clothing is recommended.

Specific Hygiene Measures: Always observe good personal hygiene measures, such as washing after handling the material and before eating, drinking, and/or smoking. Routinely wash work clothing and protective equipment to remove contaminants. Discard contaminated clothing and footwear that cannot be cleaned. Practice good housekeeping.

ENVIRONMENTAL CONTROLS

Comply with applicable environmental regulations limiting discharge to air, water and soil. Protect the environment by applying appropriate control measures to prevent or limit emissions.

SECTION 9

PHYSICAL AND CHEMICAL PROPERTIES

Note: Physical and chemical properties are provided for safety, health and environmental considerations only and may not fully represent product specifications. Contact the Supplier for additional information.

GENERAL INFORMATION

Physical State: Liquid
Color: Clear (May Be Dyed)
Odor: Petroleum/Solvent
Odor Threshold: N/D

IMPORTANT HEALTH, SAFETY, AND ENVIRONMENTAL INFORMATION

Relative Density (at 15 °C): 0.81 - 0.87
Density (at 15 °C): 810 kg/m³ (6.76 lbs/gal, 0.81 kg/dm³) - 876 kg/m³ (7.31 lbs/gal, 0.88 kg/dm³)
Flammability (Solid, Gas): N/A
Flash Point [Method]: >38°C (100°F) [ASTM D-93]
Flammable Limits (Approximate volume % in air): LEL: 0.6 UEL: 7.0
Autoignition Temperature: >200°C (392°F)
Boiling Point / Range: 145°C (293°F) - 370°C (698°F)
Decomposition Temperature: N/D
Vapor Density (Air = 1): > 2 at 101 kPa
Vapor Pressure: 0.067 kPa (0.5 mm Hg) at 20 °C
Evaporation Rate (n-butyl acetate = 1): N/D
pH: N/A
Log Pow (n-Octanol/Water Partition Coefficient): > 3.5
Solubility in Water: Negligible

Product Name: NO. 2 DIESEL FUEL
 Revision Date: 09 Jan 2015
 Page 8 of 14

Viscosity: 1.7 cSt (1.7 mm²/sec) at 40 °C - 4.1 cSt (4.1 mm²/sec) at 40 °C
Oxidizing Properties: See Hazards Identification Section.

OTHER INFORMATION

Freezing Point: N/D
Melting Point: N/A
Pour Point: < -6°C (21 °F)

SECTION 10 STABILITY AND REACTIVITY

REACTIVITY: See sub-sections below.

STABILITY: Material is stable under normal conditions.

CONDITIONS TO AVOID: Open flames and high energy ignition sources.

MATERIALS TO AVOID: Halogens, Strong Acids, Strong Bases, Strong oxidizers

HAZARDOUS DECOMPOSITION PRODUCTS: Material does not decompose at ambient temperatures.

POSSIBILITY OF HAZARDOUS REACTIONS: Hazardous polymerization will not occur.

SECTION 11 TOXICOLOGICAL INFORMATION

INFORMATION ON TOXICOLOGICAL EFFECTS

Hazard Class	Conclusion / Remarks
Inhalation	
Acute Toxicity: (Rat) 4 hour(s) LC50 4100 mg/m ³ (Vapor and aerosol)	Moderately toxic. Based on test data for structurally similar materials. Test(s) equivalent or similar to OECD Guideline 403
Irritation: No end point data for material.	Elevated temperatures or mechanical action may form vapors, mist, or fumes which may be irritating to the eyes, nose, throat, or lungs.
Ingestion	
Acute Toxicity (Rat): LD50 > 5000 mg/kg	Minimally Toxic. Based on test data for structurally similar materials. Test(s) equivalent or similar to OECD Guideline 401
Skin	
Acute Toxicity (Rabbit): LD50 > 5000 mg/kg	Minimally Toxic. Based on test data for structurally similar materials. Test(s) equivalent or similar to OECD Guideline 434
Skin Corrosion/Irritation (Rabbit): Data available.	Irritating to the skin. Based on test data for structurally similar materials. Test(s) equivalent or similar to OECD Guideline 404
Eye	
Serious Eye Damage/Irritation (Rabbit): Data available.	May cause mild, short-lasting discomfort to eyes. Based on test data for structurally similar materials. Test(s) equivalent or similar to OECD Guideline 405
Sensitization	
Respiratory Sensitization: No end point data for material.	Not expected to be a respiratory sensitizer.
Skin Sensitization: Data available.	Not expected to be a skin sensitizer. Based on test data for structurally similar materials. Test(s) equivalent or similar to OECD Guideline 406
Aspiration: Data available.	May be fatal if swallowed and enters airways. Based on physico-chemical properties of the material.

Product Name: NO. 2 DIESEL FUEL

Revision Date: 09 Jan 2015

Page 9 of 14

Germ Cell Mutagenicity: Data available.	Not expected to be a germ cell mutagen. Based on test data for structurally similar materials. Test(s) equivalent or similar to OECD Guideline 471 475
Carcinogenicity: Data available.	Caused cancer in laboratory animals, but the relevance to humans is uncertain. Based on test data for structurally similar materials. Test(s) equivalent or similar to OECD Guideline 451
Reproductive Toxicity: Data available.	Not expected to be a reproductive toxicant. Test(s) equivalent or similar to OECD Guideline 414
Lactation: No end point data for material.	Not expected to cause harm to breast-fed children.
Specific Target Organ Toxicity (STOT)	
Single Exposure: No end point data for material.	Not expected to cause organ damage from a single exposure.
Repeated Exposure: Data available.	Concentrated, prolonged or deliberate exposure may cause organ damage. Based on test data for structurally similar materials. Test(s) equivalent or similar to OECD Guideline 410 413

TOXICITY FOR SUBSTANCES

NAME	ACUTE TOXICITY
ETHYL BENZENE	Inhalation Lethality: 4 hour(s) LC50 17.8 mg/l (Vapor) (Rat); Oral Lethality: LD50 3.5 g/kg (Rat)
NAPHTHALENE	Inhalation Lethality: 4 hour(s) LC50 > 0.4 mg/l (Max attainable vapor conc.) (Rat); Oral Lethality: LD50 533 mg/kg (Mouse)

OTHER INFORMATION

For the product itself:

Target Organs Repeated Exposure: Liver, Bone marrow, Thymus

Vapor concentrations above recommended exposure levels are irritating to the eyes and the respiratory tract, may cause headaches and dizziness, are anesthetic and may have other central nervous system effects. Small amounts of liquid aspirated into the lungs during ingestion or from vomiting may cause chemical pneumonitis or pulmonary edema.

Diesel fuel: Caused cancer in animal tests. Caused mutations in vitro. Repeated dermal exposures to high concentrations in test animals resulted in reduced litter size and litter weight, and increased fetal resorptions at maternally toxic doses. Dermal exposure to high concentrations resulted in severe skin irritation with weight loss and some mortality. Inhalation exposure to high concentrations resulted in respiratory tract irritation, lung changes/infiltration/accumulation, and reduction in lung function.

Diesel exhaust fumes: Carcinogenic in animal tests. Inhalation exposures to exhaust for 2 years in test animals resulted in lung tumors and lymphoma. Extract of particulate produced skin tumors in test animals. Caused mutations in vitro.

Contains:

NAPHTHALENE: Exposure to high concentrations of naphthalene may cause destruction of red blood cells, anemia, and cataracts. Naphthalene caused cancer in laboratory animal studies, but the relevance of these findings to humans is uncertain.

ETHYLBENZENE: Caused cancer in laboratory animal studies. The relevance of these findings to humans is uncertain.

The following ingredients are cited on the lists below:

19/35

Product Name: NO. 2 DIESEL FUEL
 Revision Date: 09 Jan 2015
 Page 10 of 14

Chemical Name	CAS Number	List Citations
ETHYL BENZENE	100-41-4	5
NAPHTHALENE	91-20-3	2, 5

--REGULATORY LISTS SEARCHED--

1 = NTP CARC	3 = IARC 1	5 = IARC 2B
2 = NTP SUS	4 = IARC 2A	6 = OSHA CARC

SECTION 12	ECOLOGICAL INFORMATION
-------------------	-------------------------------

The information given is based on data available for the material, the components of the material, and similar materials.

ECOTOXICITY

Material -- Expected to be toxic to aquatic organisms. May cause long-term adverse effects in the aquatic environment.

MOBILITY

More volatile component -- Highly volatile, will partition rapidly to air. Not expected to partition to sediment and wastewater solids.

High molecular wt. component -- Low solubility and floats and is expected to migrate from water to the land. Expected to partition to sediment and wastewater solids.

PERSISTENCE AND DEGRADABILITY

Biodegradation:

Material -- Expected to be inherently biodegradable

Atmospheric Oxidation:

More volatile component -- Expected to degrade rapidly in air

ECOLOGICAL DATA

Ecotoxicity

Test	Duration	Organism Type	Test Results
Aquatic - Acute Toxicity	96 hour(s)	Fish	LL50 1 - 100 mg/l: data for similar materials
Aquatic - Acute Toxicity	48 hour(s)	Daphnia magna	EL50 1 - 1000 mg/l: data for similar materials
Aquatic - Acute Toxicity	72 hour(s)	Pseudokirchneriella subcapitata	EL50 1 - 100 mg/l: data for similar materials
Aquatic - Chronic Toxicity	72 hour(s)	Pseudokirchneriella subcapitata	NOELR 1 - 10 mg/l: data for similar materials

Persistence, Degradability and Bioaccumulation Potential

Media	Test Type	Duration	Test Results
Water	Ready Biodegradability	28 day(s)	Percent Degraded < 60 :

20/35

Product Name: NO. 2 DIESEL FUEL
Revision Date: 09 Jan 2015
Page 11 of 14

			similar material
--	--	--	------------------

SECTION 13 DISPOSAL CONSIDERATIONS

Disposal recommendations based on material as supplied. Disposal must be in accordance with current applicable laws and regulations, and material characteristics at time of disposal.

DISPOSAL RECOMMENDATIONS

Product is suitable for burning in an enclosed controlled burner for fuel value or disposal by supervised incineration at very high temperatures to prevent formation of undesirable combustion products.

REGULATORY DISPOSAL INFORMATION

RCRA Information: Disposal of unused product may be subject to RCRA regulations (40 CFR 261). Disposal of the used product may also be regulated due to ignitability, corrosivity, reactivity or toxicity as determined by the Toxicity Characteristic Leaching Procedure (TCLP). Potential RCRA characteristics: IGNITABILITY.

Empty Container Warning Empty Container Warning (where applicable): Empty containers may contain residue and can be dangerous. Do not attempt to refill or clean containers without proper instructions. Empty drums should be completely drained and safely stored until appropriately reconditioned or disposed. Empty containers should be taken for recycling, recovery, or disposal through suitably qualified or licensed contractor and in accordance with governmental regulations. DO NOT PRESSURISE, CUT, WELD, BRAZE, SOLDER, DRILL, GRIND, OR EXPOSE SUCH CONTAINERS TO HEAT, FLAME, SPARKS, STATIC ELECTRICITY, OR OTHER SOURCES OF IGNITION. THEY MAY EXPLODE AND CAUSE INJURY OR DEATH.

SECTION 14 TRANSPORT INFORMATION

LAND (DOT)

Proper Shipping Name: DIESEL FUEL
Hazard Class & Division: COMBUSTIBLE LIQUID
ID Number: NA1993
Packing Group: III
Marine Pollutant: Yes
ERG Number: 128
Label(s): NONE
Transport Document Name: NA1993, DIESEL FUEL, COMBUSTIBLE LIQUID, PG III, MARINE POLLUTANT

Footnote: The flash point of this material is greater than 100 F. Regulatory classification of this material varies. DOT: Flammable liquid or combustible liquid. OSHA: Combustible liquid. IATA/IMO: Flammable liquid.

LAND (TDG)

Proper Shipping Name: GAS OIL
Hazard Class & Division: 3
UN Number: 1202
Packing Group: III

SEA (IMDG)

Proper Shipping Name: GAS OIL

21/35

Product Name: NO. 2 DIESEL FUEL
 Revision Date: 09 Jan 2015
 Page 12 of 14

Hazard Class & Division: 3
EMS Number: F-E, S-E
UN Number: 1202
Packing Group: III
Marine Pollutant: Yes
Label(s): 3
Transport Document Name: UN1202, GAS OIL, 3, PG III, (55°C c.c.), MARINE POLLUTANT

AIR (IATA)

Proper Shipping Name: GAS OIL
Hazard Class & Division: 3
UN Number: 1202
Packing Group: III
Label(s) / Mark(s): 3
Transport Document Name: UN1202, GAS OIL, 3, PG III

SECTION 15 REGULATORY INFORMATION

OSHA HAZARD COMMUNICATION STANDARD: This material is considered hazardous in accordance with OSHA HazCom 2012, 29 CFR 1910.1200.

Listed or exempt from listing/notification on the following chemical inventories: AICS, DSL, IECSC, KECI, PICCS, TSCA

EPCRA SECTION 302: This material contains no extremely hazardous substances.

CERCLA: This material is not subject to any special reporting under the requirements of the Comprehensive Environmental Response, Compensation and Liability Act (CERCLA). Contact local authorities to determine if other reporting requirements apply.

SARA (311/312) REPORTABLE HAZARD CATEGORIES: Fire. Immediate Health. Delayed Health.

SARA (313) TOXIC RELEASE INVENTORY:

Chemical Name	CAS Number	Typical Value
NAPHTHALENE	91-20-3	0.1 - 1%
ETHYL BENZENE	100-41-4	0.1 - 1%

The following ingredients are cited on the lists below:

Chemical Name	CAS Number	List Citations
DIESEL OIL..C9-20	68334-30-5	1, 18
ETHYL BENZENE	100-41-4	1, 4, 10, 17, 19
NAPHTHALENE	91-20-3	1, 4, 10, 17, 19

22/35

Product Name: NO. 2 DIESEL FUEL

Revision Date: 09 Jan 2015

Page 13 of 14

--REGULATORY LISTS SEARCHED--

1 = ACGIH ALL	6 = TSCA 5a2	11 = CA P65 REPRO	16 = MN RTK
2 = ACGIH A1	7 = TSCA 5e	12 = CA RTK	17 = NJ RTK
3 = ACGIH A2	8 = TSCA 6	13 = IL RTK	18 = PA RTK
4 = OSHA Z	9 = TSCA 12b	14 = LA RTK	19 = RI RTK
5 = TSCA 4	10 = CA P65 CARC	15 = MI 293	

Code key: CARC=Carcinogen; REPRO=Reproductive

SECTION 16

OTHER INFORMATION

This warning is given to comply with California Health and Safety Code 25249.6 and does not constitute an admission or a waiver of rights. This product contains a chemical known to the State of California to cause cancer, birth defects, or other reproductive harm. Chemicals known to the State of California to cause cancer, birth defects, or other reproductive harm are created by the combustion of this product.

N/D = Not determined, N/A = Not applicable

KEY TO THE H-CODES CONTAINED IN SECTION 3 OF THIS DOCUMENT (for information only):

H225: Highly flammable liquid and vapor; Flammable Liquid, Cat 2

H226: Flammable liquid and vapor; Flammable Liquid, Cat 3

H302: Harmful if swallowed; Acute Tox Oral, Cat 4

H304: May be fatal if swallowed and enters airways; Aspiration, Cat 1

H315: Causes skin irritation; Skin Corr/Irritation, Cat 2

H332: Harmful if inhaled; Acute Tox Inh, Cat 4

H351: Suspected of causing cancer; GHS Carcinogenicity, Cat 2

H373: May cause damage to organs through prolonged or repeated exposure; Target Organ, Repeated, Cat 2

H400: Very toxic to aquatic life; Acute Env Tox, Cat 1

H401: Toxic to aquatic life; Acute Env Tox, Cat 2

H410: Very toxic to aquatic life with long lasting effects; Chronic Env Tox, Cat 1

H411: Toxic to aquatic life with long lasting effects; Chronic Env Tox, Cat 2

THIS SAFETY DATA SHEET CONTAINS THE FOLLOWING REVISIONS:

Updates made in accordance with implementation of GHS requirements.

THIS MSDS COVERS THE FOLLOWING MATERIALS: DIESEL NO. 2 | ESSO DIESEL FUEL | EXXON DIESEL FUEL | LOW SULFUR DIESEL | MARINE DIESEL FUEL | MOBIL DIESEL FUEL | ULTRA LOW SULFUR DIESEL | WINTERIZED DIESEL FUEL

The information and recommendations contained herein are, to the best of ExxonMobil's knowledge and belief, accurate and reliable as of the date issued. You can contact ExxonMobil to insure that this document is the most current available from ExxonMobil. The information and recommendations are offered for the user's consideration and examination. It is the user's responsibility to satisfy itself that the product is suitable for the intended use. If buyer repackages this product, it is the user's responsibility to insure proper health, safety and other necessary information is included with and/or on the container. Appropriate warnings and safe-handling procedures should be provided to handlers and users. Alteration of this document is strictly prohibited. Except to the extent required by law, re-publication or retransmission of this document, in whole or in part, is not permitted. The term, "ExxonMobil" is used for convenience, and may include any one or more of ExxonMobil Chemical Company, Exxon Mobil Corporation, or any affiliates in which they directly or indirectly hold any interest.



Product Name: NO. 2 DIESEL FUEL
Revision Date: 09 Jan 2015
Page 14 of 14

Internal Use Only

MHC: 1A, 0B, 2, 0, 4, 1

PPEC: C

DGN: 7079307XUS (1012398)

Copyright 2002 Exxon Mobil Corporation, All rights reserved

24/35

Attachment E

Calculations and Supporting Documents

**Emissions Definitions Regarding John Deere 4045TF280D Used in MTU Onsite Energy
50 kW Stationary Gen Application Operation at 75% Capacity
POTENTIAL Emissions Rates given by Technical Specs in lb/hr**

Certified Values for this specific engine were used in the below calculations. Carb Certification attached on Page 27. Since the motor meets Tier 3 requirements they emit no more than what is specified in 40 CFR §89.112, Table 1. **For annual POTENTIAL calculations, 8760 hrs/year was used. The generator will be used intermittently (<500 hrs/yr).**

NO_x - on the attached EPA Engine Certification

Hourly NO_x = 4.17 g/kW-hr * 50 kW * 1 lb/453.592g = 0.46 lb/hr

Annual NO_x = 0.46 lb/hr * 8760 hr/yr * 1 ton /2000lbs = 2.01 ton/yr

CO - on the attached EPA Engine Certification

Hourly CO = 1.1 g/kW-hr * 50 kW * 1 lb/453.592g = 0.12 lb/hr

Annual CO = 0.12 lb/hr * 8760 hr/yr * 1ton/2000lbs = 0.53 ton/yr

PM - on the attached EPA Engine Certification

Hourly PM = 0.24 g/kW-hr * 50 kW * 1 lb/453.592g = 0.03 lb/hr

Annual PM = 0.03 lb/hr * 8760 hr/yr * 1ton/2000 lb = 0.12 ton/yr

HC - on the attached EPA Engine Certification

Hourly HC = 0.3 g/kW-hr * 50 kW * 1 lb/453.592g = 0.03 lb/hr

Annual HC = 0.03 lb/hr * 8760 hr/yr * 1ton/2000 lb = 0.14 ton/yr

VOC - AP42

Per AP-42 Table 3.3-1, the emission factor of #2 Diesel Fuel is 0.00247 lb/hp-hr

Hourly VOC = 0.00247 lb/hp-hr * 67 bhp = 0.165 lb/hr

Yearly VOC = 0.165 lb/hr * 8760 hr/yr * 1 ton/2000 lb = 0.73 ton/yr

SO_x - AP42

Per AP-42 Table 3.3-1, the emission factor of #2 Diesel Fuel is 0.00205 lb/hp-hr

Hourly SO₂ = 0.00205 lb/hp-hr * 67 bhp = 0.137 lb/hr

Yearly SO₂ = 0.137 lb/hr * 8760 hr/yr * 1ton/2000 lb = 0.60 ton/yr

Formaldehyde - AP42

Per AP-42 Table 3.3-2, the emission factor of #2 Diesel Fuel is 0.00118 lb/hp-hr

Hourly VOC = 0.00118 lb/hp-hr * 67 bhp = 0.08 lb/hr

Yearly formaldehyde = 0.08 lb/hr * 8760 hr/yr * 1ton/2000 lb = 0.35 ton/yr

**Emissions Definitions Regarding John Deere 4045TF280D Used in MTU Onsite Energy
50 kW Stationary Gen Application Operation at 75% Capacity
ACTUAL Emissions Rates given by Technical Specs in lb/hr**

Certified Values for this specific engine were used in the below calculations. Carb Certification attached
Since the motor meets Tier 3 requirements they emit no more than what is specified in
**40 CFR §89.112, Table 1. For annual ACTUAL calculations, 500 hrs/year was used. The generator
will be used intermittently.**

NOx - on the attached EPA Engine Certification

Hourly NOx = 4.17 g/kW-hr * 50 kW * 1 lb/453.592g = 0.46 lb/hr

Annual NOx = 0.46 lb/hr * 500 hr/yr * 1 ton /2000lbs = 0.11 ton/yr

CO - on the attached EPA Engine Certification

Hourly CO = 1.1 g/kW-hr * 50 kW * 1 lb/453.592g = 0.12 lb/hr

Annual CO = 0.12 lb/hr * 500 hr/yr * 1ton/2000lbs = 0.03 ton/yr

PM - on the attached EPA Engine Certification

Hourly PM = 0.24 g/kW-hr * 50 kW * 1 lb/453.592g = 0.03 lb/hr

Annual PM = 0.03 lb/hr * 500 hr/yr * 1ton/2000 lb= 0.007 ton/yr

HC - on the attached EPA Engine Certification

Hourly HC = 0.3 g/kW-hr * 50 kW * 1 lb/453.592g = 0.03 lb/hr

Annual HC = 0.03 lb/hr * 500 hr/yr * 1ton/2000 lb= 0.007 ton/yr

VOC - AP42

Per AP-42 Table 3.3-1, the emission factor of #2 Diesel Fuel is 0.00247 lb/hp-hr

Hourly VOC = 0.00247 lb/hp-hr * 67 bhp = 0.165 lb/hr

Yearly VOC = 0.165 lb/hr * 500 hr/yr * 1 ton/2000 lb= 0.04 ton/yr

SOx - AP42

Per AP-42 Table 3.3-1, the emission factor of #2 Diesel Fuel is 0.00205 lb/hp-hr

Hourly SO2 = 0.00205 lb/hp-hr * 67 bhp = 0.137 lb/hr

Yearly SO2 = 0.137 lb/hr * 500 hr/yr * 1ton/2000 lb= 0.03 ton/yr

Formaldehyde - AP42

Per AP-42 Table 3.3-2, the emission factor of #2 Diesel Fuel is 0.00118 lb/hp-hr

Hourly VOC = 0.00118 lb/hp-hr * 67 bhp = 0.08 lb/hr

Yearly formaldehyde = 0.08 lb/hr * 500 hr/yr * 1ton/2000 lb= 0.02 ton/yr

Rating Specific Emissions Data - John Deere Power Systems



Rating Data

Rating	4045TF280D	
Certified Power(kW)	63	
Rated Speed	1800	
Vehicle Model Number	OEM (Gen Set-Emergency)	
Units	g/kW-hr	g/hp-hr
NOx	4.17	3.11
HC	0.30	0.22
NOx + HC	N/A	N/A
Pm	0.24	0.18
CO	1.1	0.8

Certificate Data

Engine Model Year	2015	
EPA Family Name	FJDXL04.5141	
EPA JD Name	350HAM	
EPA Certificate Number	FJDXL04.5141-005	
CARB Executive Order		
Parent of Family	4045HFG81	
Units	g/kW-hr	
NOx	4.18	
HC	0.24	
NOx + HC	N/A	
Pm	0.22	
CO	0.6	

* The emission data listed is measured from a laboratory test engine according to the test procedures of 40 CFR 89 or 40 CFR 1039, as applicable. The test engine is intended to represent nominal production hardware, and we do not guarantee that every production engine will have identical test results. The family parent data represents multiple ratings and this data may have been collected at a different engine speed and load. Emission results may vary due to engine manufacturing tolerances, engine operating conditions, fuels used, or other conditions beyond our control.

This information is property of Deere & Company. It is provided solely for the purpose of obtaining certification or permits of Deere powered equipment. Unauthorized distribution of this information is prohibited.

Emissions Results by Rating run on Dec-11-2014

28/35

DIESEL GENERATOR SET

MTU 4R0113 DS50

50 kWe / 60 Hz / Standby
208 - 600V

Reference MTU 4R0113 DS50 (45 kWe) for Prime Rating Technical Data



SYSTEM RATINGS

Standby

Voltage (L-L)	240V**	240V**	208V**	240V**	380V**	480V**	600V**
Phase	1	1	3	3	3	3	3
PF	1	1	0.8	0.8	0.8	0.8	0.8
Hz	60	60	60	60	60	60	60
kW	51	52	51	51	50	52	52
kVA	51	52	63.75	63.75	62.5	65	65
Amps	212	216	177	153	95	78	62
skVA@30%							
Voltage Dip	127	130	129	129	173	172	138
Generator							
Model	362CSL1604	361CSL1613	361CSL1601	361CSL1601	361CSL1601	361CSL1601	361PSL1633
Temp Rise	130 °C/40 °C	130 °C/40 °C	130 °C/40 °C	130 °C/40 °C	130 °C/40 °C	130 °C/40 °C	130 °C/40 °C
Connection	12 LEAD DOUBLE DELTA	4 LEAD	12 LEAD LOW WYE	12 LEAD HI DELTA	12 LEAD HI WYE	12 LEAD HI WYE	4 LEAD WYE

** UL 2200 Offered

CERTIFICATIONS AND STANDARDS

// Emissions – EPA Tier 3 Certified

// Generator set is designed and manufactured in facilities certified to standards ISO 9001:2008 and ISO 14001:2004

// UL 2200 / CSA – Optional
- UL 2200 Listed
- CSA Certified

// Performance Assurance Certification (PAC)

- Generator Set Tested to ISO 8528-5 for Transient Response
- Verified product design, quality and performance integrity
- All engine systems are prototype and factory tested

// Power Rating

- Accepts Rated Load in One Step Per NFPA 110

29/35

STANDARD FEATURES*

- // MTU Onsite Energy is a single source supplier
- // Global Product Support
- // 2 Year Standard Warranty
- // 4045TF280 Diesel Engine
 - 4.5 Liter Displacement
 - Mechanical Injection Pump
 - 4-Cycle
- // Engine-generator resilient mounted
- // Complete Range of Accessories
- // Generator
 - Brushless, Rotating Field Generator
 - 2/3 Pitch Windings
 - 300% Short Circuit Capability with Optional PMG
- // Digital Control Panel(s)
 - UL Recognized, CSA Certified, NFPA 110
 - Complete System Metering
 - LCD Display
- // Cooling System
 - Integral Set-Mounted
 - Engine Driven Fan

STANDARD EQUIPMENT*

// Engine

Air Cleaner
 Oil Pump
 Oil Drain Extension & S/O Valve
 Full Flow Oil Filter
 Fuel Filter with Water Separator
 Jacket Water Pump
 Thermostat
 Blower Fan & Fan Drive
 Radiator - Unit Mounted
 Electric Starting Motor - 12V
 Governor - Mechanical Droop
 Base - Formed Steel
 SAE Flywheel & Bell Housing
 Charging Alternator - 12V
 Battery Box & Cables
 Flexible Fuel Connectors
 Flexible Exhaust Connection
 EPA Certified Engine

// Generator

NEMA MG1, IEEE and ANSI standards compliance for temperature rise and motor starting
 Self-Ventilated and Drip-Proof
 Superior Voltage Waveform
 Solid State, Volts-per-Hertz Regulator
 $\pm 1\%$ Voltage Regulation No Load to Full Load
 Brushless Alternator with Brushless Pilot Exciter
 4 Pole, Rotating Field

130 °C Maximum Standby Temperature Rise
 1 Bearing, Sealed
 Flexible Coupling
 Full Amortisseur Windings
 125% Rotor Balancing
 3-Phase Voltage Sensing
 100% of Rated Load - One Step
 5% Maximum Total Harmonic Distortion

// Digital Control Panel(s)

Digital Metering
 Engine Parameters
 Generator Protection Functions
 Engine Protection
 Windows®-Based Software
 Multilingual Capability
 Remote Communications to RDP-110 Remote Annunciator
 Programmable Input and Output Contacts
 UL Recognized, CSA Certified, CE Approved
 Event Recording
 IP 54 Front Panel Rating with Integrated Gasket
 NFPA110 Compatible

* Represents standard product only. Consult Factory/MTU Onsite Energy Distributor for additional configurations.

APPLICATION DATA

// Engine

Manufacturer	John Deere
Model	4045TF280
Type	4-Cycle
Arrangement	4-Inline
Displacement: L (in ³)	4.5 (275)
Bore: cm (in)	10.6 (4.19)
Stroke: cm (in)	12.7 (5)
Compression Ratio	19.0:1
Rated RPM	1,800
Engine Governor	Mechanical Droop
Maximum Power: kWm (bhp)	63 (85)
Speed Regulation	±0.5%
Air Cleaner	Dry

// Liquid Capacity (Lubrication)

Total Oil System: L (gal)	13 (3.4)
Engine Jacket Water Capacity: L (gal)	8.5 (2.3)
System Coolant Capacity: L (gal)	18.9 (5)

// Electrical

Electric Volts DC	12
Cold Cranking Amps Under -17.8 °C (0 °F)	925

// Fuel System

Fuel Supply Connection Size	3/8" NPT
Fuel Return Connection Size	3/8" NPT
Maximum Fuel Lift: m (ft)	1.8 (6)
Recommended Fuel	Diesel #2
Total Fuel Flow: L/hr (gal/hr)	62.5 (16.5)

// Fuel Consumption

At 100% of Power Rating: L/hr (gal/hr)	17.4 (4.6)
At 75% of Power Rating: L/hr (gal/hr)	13.6 (3.6)
At 50% of Power Rating: L/hr (gal/hr)	9.5 (2.5)

// Cooling - Radiator System

Ambient Capacity of Radiator: °C (°F)	50 (122)
Maximum Allowable Static	
Pressure on Rad. Exhaust: kPa (in. H ₂ O)	0.12 (0.5)
Water Pump Capacity: L/min (gpm)	144 (38)
Heat Rejection to Coolant: kW (BTUM)	36 (2,049)
Heat Radiated to Ambient: kW (BTUM)	8.7 (495)
Fan Power: kW (hp)	1.6 (2.2)

// Air Requirements

Aspirating: *m ³ /min (SCFM)	5.3 (187)
Air Flow Required for Rad.	
Cooled Unit: *m ³ /min (SCFM)	117 (4,088)
Remote Cooled Applications;	
Air Flow Required for Dissipation of Radiated Gen-set Heat for a	
Max of 25 °F Rise: *m ³ /min (SCFM)	32 (1,117)


* Air density = 1.184 kg/m³ (0.0739 lbm/ft³)

// Exhaust System

Gas Temp. (Stack): °C (°F)	579 (1,074)
Gas Volume at Stack	
Temp: m ³ /min (CFM)	19.2 (679)
Maximum Allowable	
Back Pressure: kPa (in. H ₂ O)	7.5 (30)
Minimum Allowable	
Back Pressure: kPa (in. H ₂ O)	N/A

31/35

WEIGHTS AND DIMENSIONS

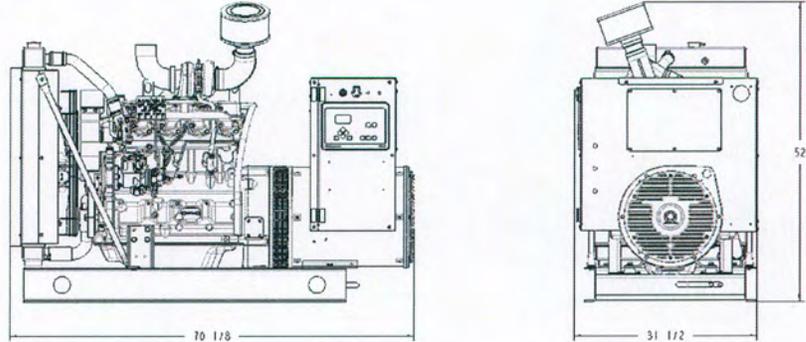

Drawing above for illustration purposes only, based on standard open power 480 volt generator set. Lengths may vary with other voltages. Do not use for installation design. See website for unit specific template drawings.

System Open Power Unit (OPU)	Dimensions (L x W x H) 1,781 x 800 x 1,321 mm (70.13 x 31.5 x 52 in)	Weight (dry/less tank) 872 kg (1,920 lb)
--	--	--

Weights and dimensions are based on open power units and are estimates only. Consult the factory for accurate weights and dimensions for your specific generator set.

SOUND DATA

Unit Type Level 0: Open Power Unit dB(A)	Standby Full Load 80.5
--	----------------------------------

Sound data is provided at 7 m (23 ft). Generator set tested in accordance with ISO 8528-10 and with infinite exhaust.

EMISSIONS DATA

NO_x + NMHC 3.86	CO 0.7	PM 0.23
--------------------------------------	------------------	-------------------

All units are in g/hp-hr and shown at 100% load (not comparable to EPA weighted cycle values).

Emission levels of the engine may vary with ambient temperature, barometric pressure, humidity, fuel type and quality, installation parameters, measuring instrumentation, etc. The data was obtained in compliance with US EPA regulations. The weighted cycle value (not shown) from each engine is guaranteed to be within the US EPA Standards.

RATING DEFINITIONS AND CONDITIONS

// Standby ratings apply to installations served by a reliable utility source. The standby rating is applicable to varying loads for the duration of a power outage. No overload capability for this rating. Ratings are in accordance with ISO 3046-1, BS 5514, and AS 2789. Average load factor: ≤ 85%.

// Deration Factor:

Altitude: Consult your local MTU Onsite Energy Power Generation Distributor for altitude derations.

Temperature: Consult your local MTU Onsite Energy Power Generation Distributor for temperature derations.

C/F = Consult Factory/MTU Onsite Energy Distributor

N/A = Not Available

MTU Onsite Energy
A Rolls-Royce Power Systems Brand

www.mtuonsiteenergy.com

32/35

